

# PUBLISHED VERSION

Mai Bui, Indra Gunawan, Vincent Verheyen, Yuli Artanto, Erik Meuleman, Paul Feron  
**Dynamic modeling and validation of post-combustion CO<sub>2</sub> Capture Plants in Australian Coal-fired Power Stations**

Proceedings of the 11th International Conference on Greenhouse Gas Control Technologies, as published in Energy Procedia, 2012; 37:2694-2702

© 2013 The Authors. Under a Creative Commons license [<http://creativecommons.org/licenses/by-nc-nd/3.0/>]

Originally published at:

<http://dx.doi.org/10.1016/j.egypro.2013.06.154>

## PERMISSIONS

<http://creativecommons.org/licenses/by-nc-nd/3.0/>



Attribution-NonCommercial-NoDerivs 3.0 Unported (CC BY-NC-ND 3.0)

This is a human-readable summary of (and not a substitute for) the [license](#).

[Disclaimer](#)

### You are free to:

**Share** — copy and redistribute the material in any medium or format

The licensor cannot revoke these freedoms as long as you follow the license terms.

### Under the following terms:



**Attribution** — You must give **appropriate credit**, provide a link to the license, and **indicate if changes were made**. You may do so in any reasonable manner, but not in any way that suggests the licensor endorses you or your use.



**NonCommercial** — You may not use the material for **commercial purposes**.



**NoDerivatives** — If you **remix, transform, or build upon** the material, you may not distribute the modified material.

**No additional restrictions** — You may not apply legal terms or **technological measures** that legally restrict others from doing anything the license permits.

GHGT-11

## Dynamic modeling and validation of post-combustion CO<sub>2</sub> capture plants in Australian coal-fired power stations

Mai Bui<sup>a</sup>, Indra Gunawan<sup>a\*</sup>, Vincent Verheyen<sup>a</sup>, Yuli Artanto<sup>b</sup>, Erik Meuleman<sup>b</sup>, Paul Feron<sup>c</sup>

<sup>a</sup> School of Applied Science and Engineering, Monash University, Gippsland Campus, Northways Road, Churchill 3842, Victoria, Australia

<sup>b</sup> Division of Energy Technology, CSIRO, Clayton 3168, Victoria, Australia

<sup>c</sup> Division of Energy Technology, CSIRO, Newcastle, New South Wales, Australia

### Abstract

Flexible operation of post-combustion CO<sub>2</sub> capture (PCC) plants can improve efficiency through coordinating the balance between consumer demands for electricity and CO<sub>2</sub> emission reductions. This strategy however, will impose process disturbances while the PCC plant is ramped up, ramped down or turned off. This paper presents the preliminary development of a dynamic model for PCC in a brown coal-fired power plant using the process simulation software Aspen Plus Dynamics. Validation of the dynamic model will be against both steady state and dynamic data from the pilot plant. By gaining this understanding of the dynamic behavior, the technical and financial performance of PCC can be optimised.

© 2013 The Authors. Published by Elsevier Ltd.  
Selection and/or peer-review under responsibility of GHGT

*Keywords:* Dynamic process modelling; flexible operation; post-combustion CO<sub>2</sub> capture; coal-fired power stations; process optimisation, model validation

### Nomenclature and Abbreviations

PCC	post-combustion CO <sub>2</sub> capture
CO <sub>2</sub>	carbon dioxide

\* Corresponding author. Tel.: +61-3-99026639  
E-mail address: [indra.gunawan.monash.edu](mailto:indra.gunawan.monash.edu)

GHG	greenhouse gas
CCS	CO <sub>2</sub> capture and sequestration
SO <sub>x</sub>	sulphur oxide
NO <sub>x</sub>	nitrogen oxide
FGD	flue gas desulphurisation
deNO <sub>x</sub>	denitrification
ABS	absorber
FPT	flue gas pre-treatment
ABS-T01	temperature sensor 01 on the absorber column
FPT-T03	temperature sensor 03 on the flue gas pre-treatment column

## 1. Introduction

Fossil-fuelled power generators produce one quarter of the global greenhouse gas (GHG) emissions in terms of CO<sub>2</sub>-equivalent emissions, where carbon dioxide (CO<sub>2</sub>) contributes 80% of total GHG emission [1]. The combustion of brown coal emits more CO<sub>2</sub> compared to the dominant fossil fuels [2]. The majority of electricity worldwide is generated from coal due to its wide availability, stability of supply and low cost [3]. In Australia, coal-fired power plants supply 86% of the country's electricity [4].

Subsequently, significant reductions in GHG emissions can be achieved through CO<sub>2</sub> capture and sequestration (CCS) from existing fossil-fuelled power stations. The strong motivation to continue development and deployment of clean energy and CO<sub>2</sub> capture has resulted in a number of CCS demonstrations worldwide [5]. The International Energy Agency (IEA) has indicated that CCS will play a vital role in reducing CO<sub>2</sub> emissions to half of 2005 levels by 2050 [5].

One conventional strategy for CO<sub>2</sub> capture from coal-fired power stations involves the use of various solvents for absorption from flue gas. In fact with a number of PCC pilot plants around the world, the development of amine-based solvent for post-combustion CO<sub>2</sub> capture (PCC) has advanced considerably. Shown in **Error! Reference source not found.**, PCC is suitable for retrofit to existing fossil fuel-fired power plants and has the capacity to treat flue gas streams with low CO<sub>2</sub> partial pressure [6, 7]. The major drawback of PCC is the large energy requirement, as well as the high capital and operational cost. Additionally, amine-based PCC solvents are susceptible to chemical degradation by sulphur oxide (SO<sub>x</sub>) and nitrogen oxide (NO<sub>x</sub>) present in flue gas. Degradation will decrease the CO<sub>2</sub> absorption capacity of the solvent, which consequently results in higher cost of electricity [8, 9]. In Australia, the lack of legislative requirements for flue gas desulphurisation (FGD) and denitrification (deNO<sub>x</sub>) units in power plants results in further capital and operating expenses [10].

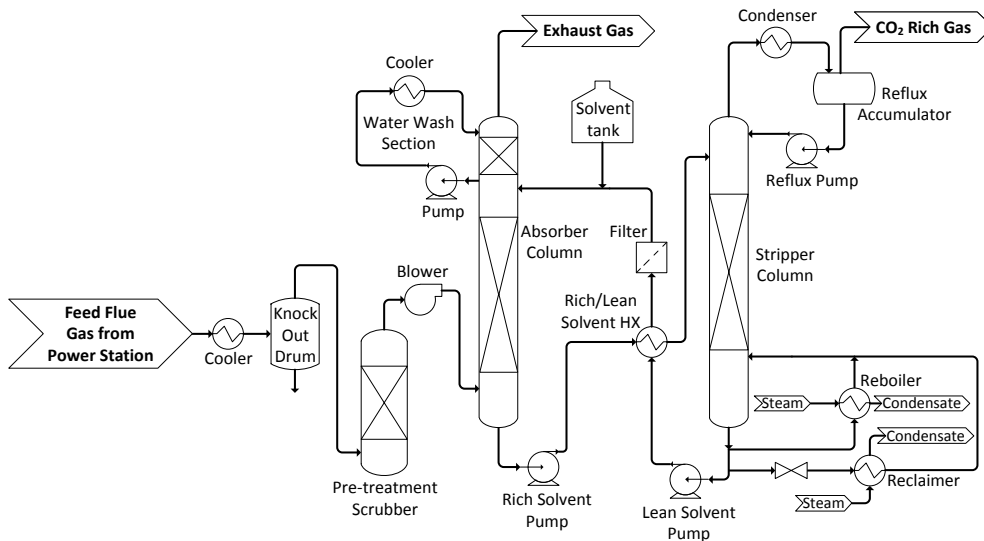


Fig. 1. The post-combustion CO<sub>2</sub> capture process including the pre-treatment of flue gas to remove particulates and neutralise contaminants such as SO<sub>x</sub> and NO<sub>x</sub>, required under Australian condition.

Flexible operation of PCC is one approach which has been proposed as a means of addressing the energy penalty during peak periods for electricity demand. For periods of low energy demand, electricity prices will be lower and capture rates may be ramped up accordingly. Conversely, electricity prices will be higher during high demand periods, thus capture may be turned down or switched off completely [11]. Therefore, flexible capture plant operation minimizes the parasitic load on the power plant at crucial periods in the energy market and maximizes financial performance. Flexible operation of CO<sub>2</sub> capture imposes process disturbances and further investigation of dynamic behavior is required. Further detail of other flexible operation strategies are discussed in the methodology section.

The paper presents the initial development of a dynamic model of the CO<sub>2</sub> absorption process in a brown coal-fired power plant with the process simulation software Aspen Plus Dynamics. Through studying the dynamic behavior of the CO<sub>2</sub> capture process, the process can be optimized for flexible PCC operation under Australian conditions to maximize technical and financial performance.

## 2. Methodology

### 2.1. Development of Dynamic PCC Model

The dynamic model of the CO<sub>2</sub> absorption process in a brown coal-fired power plant is under development using the process simulation software Aspen Plus Dynamics. The preliminary results from the model are based on the specifications of the CSIRO PCC pilot plant located at the Loy Yang brown coal fired power station in Victoria's Latrobe Valley, Australia. The PCC pilot plant is operated by CSIRO, consisting of a gas pre-treatment and cooling column, two absorption columns and one stripper column, where Pall ring packing is used in all columns. The pre-treatment column is a caustic wash column for cooling, conditioning and removal of SO<sub>x</sub>, NO<sub>x</sub> and particulate.

The validation of the dynamic PCC model for both steady state and dynamic cases is being undertaken using data from the PCC pilot plant. This involves the verification of model predictions against pilot plant data for CO<sub>2</sub> loading at various points and temperature profile in all columns. Validation will demonstrate the accuracy and reliability of model predictions. The reconfiguration and optimization of the validated dynamic CO<sub>2</sub> capture process model for flexible operation are under investigation, discussed further in the next section.

## 2.2. Flexible Operation Strategies

The development of novel flexible operation strategies to improve process performance and reduce the environmental impact of brown coal power generation will be undertaken using an optimized dynamic PCC model. The investigation will also identify key components and equipment within PCC process that have a significant influence on the process performance during flexible operation.

One flexible operation strategy is to use different operation modes such as partial capture, part-time capture or variable capture, these are summarized in **Error! Reference source not found.**. The flexible operation mode and capture rate percentage is selected based on the trends in the electricity demand. Another approach to flexible PCC operation is to configure the CO<sub>2</sub> capture plant by incorporating a bypass system or solvent storage tanks. Solvent regeneration for PCC requires heat that is sourced from steam that has been diverted from the steam turbine in the power plant. However, steam extraction would lengthen the start up and shut-down times of the power plant [12]. Therefore, it is necessary to include a system that allows feed flue gas to bypass the entire PCC process and vents excess flue gas, ensuring operation of the power plant is independent of the PCC process [13]. An alternative bypass system is shown in **Error! Reference source not found.** (a), where a bypass valve within the PCC process redirects the rich solvent back to the absorber. The result is a decrease in CO<sub>2</sub> capture and increase in power plant output [14], providing additional flexibility for periods of high electricity demand.

The addition of a solvent storage system can further improve the flexibility of the PCC process. The solvent storage system in **Error! Reference source not found.** (b) consists of two storage tanks. When power prices are high, rich solvent exiting the absorber is stored in one tank while lean solvent stored in the other equally-sized tank is utilized for CO<sub>2</sub> absorption. When electricity demand is low, stored rich solvent is regenerated in the stripper and lean solvent exiting the stripper accumulates in the other storage tank [3, 14, 15].

Table 1. Operation strategies for flexible operation of a post-combustion CO<sub>2</sub> capture plant.

Operation Mode	CO <sub>2</sub> Capture Rate %	Description
Full time complete CO <sub>2</sub> capture	One capture rate >90%	Full time capture with a constant CO <sub>2</sub> capture rate.
Partial CO <sub>2</sub> capture	One capture rate <90%	Full time capture of CO <sub>2</sub> at constant recovery rate, residual portion of CO <sub>2</sub> is vented with exhaust flue gas.
Part-time CO <sub>2</sub> capture	One capture rate One CO <sub>2</sub> capture percentage	Capture is on for selected intervals of time when electricity demand is low. CO <sub>2</sub> capture is off when electricity demand is high and flue gas is vented
Variable CO <sub>2</sub> capture	Multiple capture rate percentages	Different CO <sub>2</sub> capture rate percentages for selected time intervals allocated based on the trends electricity demand, capture plant is built to capacity specifications

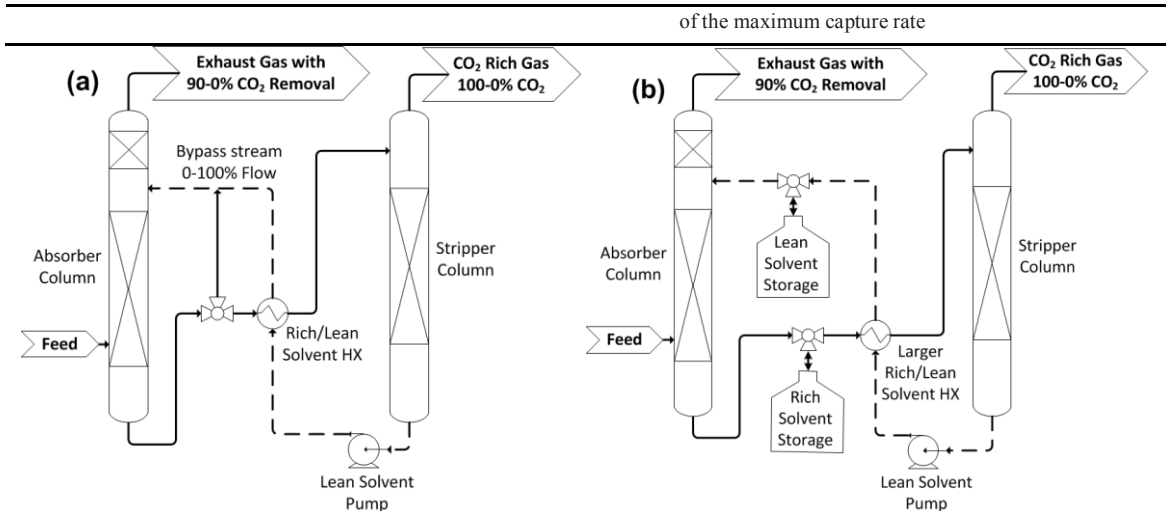


Fig. 2. Flexible operation strategies for a PCC plant can involve the integration of (a) a bypass system or (b) solvent storage tanks.

The optimal operation strategy can be determined by implementing each of these flexible operation strategies into the dynamic model. Evaluation of the flexible PCC model will be based on both economic and technical factors.

### 3. Preliminary Results and Discussion

Dynamic process models of CO<sub>2</sub> capture systems are usually only validated with steady state pilot plant data as there is a general lack of dynamic pilot plant data available [6, 16-23]. Most pilot plants are typically operated at steady state and not equipped for collecting consistent dynamic data. The major problem with collecting dynamic data is the reproducibility difficulties during these transient periods of pilot plant operation (i.e. start-up or shut down).

The CSIRO pilot plant at Loy Yang Power uses sensors to monitor flow rate, pressure and temperature throughout the entire plant. The pilot plant does not have sensors fitted for simultaneous online measurements of CO<sub>2</sub> loading at various points in the process. Instead, solvent is sampled at various points in the pilot plant during steady state operation and a liquid analysis provides CO<sub>2</sub> loading readings. The GASMET gas analyser provides measurement of gas composition. The pilot plant absorber column temperature profile in **Error! Reference source not found.** demonstrates that even at “steady state” operation where flue gas flow rate is constant, there will be significant fluctuations in temperature, pressure and flow rate. Therefore, “steady state” operation of the pilot plant operation is technically always dynamic, suggesting process plant operation is never truly a constant value steady state.

Obtaining reproducible steady state pilot plant data can be challenging since steady state operation is difficult to maintain due to changes in ambient temperature and CO<sub>2</sub> concentration of the feed flue gas. Consequently, the data collection for dynamic pilot plant behaviour will be a challenge due to technical obstacles and data reproducibility issues. Additionally, dynamic pilot plant data measurements will need to account for time variation. One key process parameter is residence time for individual equipment [24], which in turn has a significant influence on the response time of the system to parameter changes.

Therefore when considering all of these factors, it can be anticipated that the procedure for collecting reproducible dynamic data will need a considerable amount of time to fine tune and perfect.

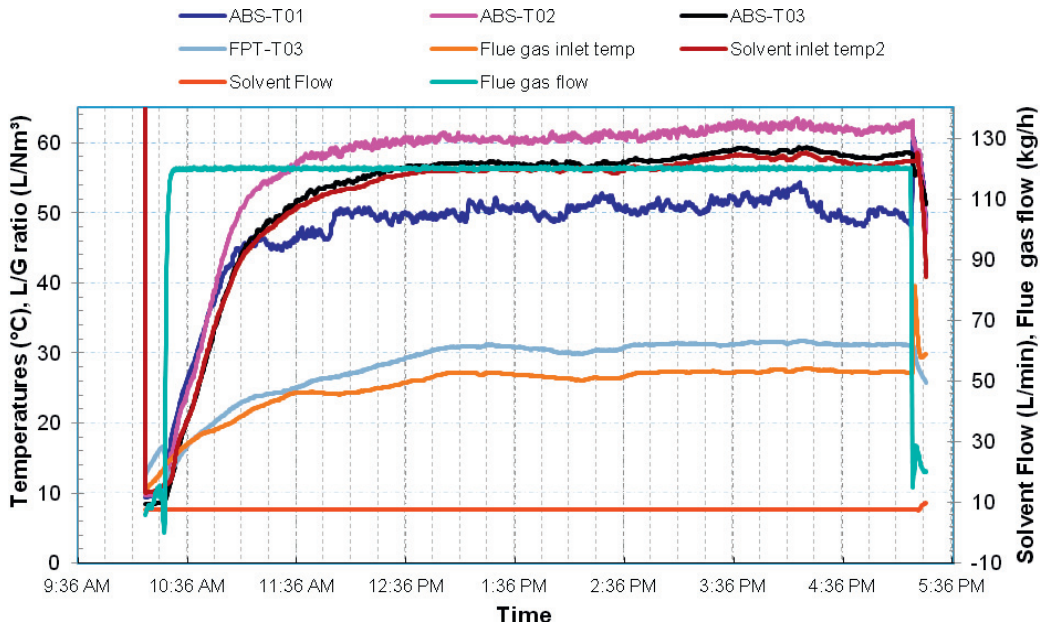


Fig. 3. Temperature profile of absorber column 2 at the CSIRO PCC pilot plant at Loy Yang Power on the date of 13 August 2012. The temperature transmitters (ABS-T01 to ABS-T02) are at various points on the absorber column; FPT-T03 is the temperature of the flue gas exiting the pre-treatment process. Note the scale for solvent flow and exit CO<sub>2</sub> gas flow is on the right hand side.

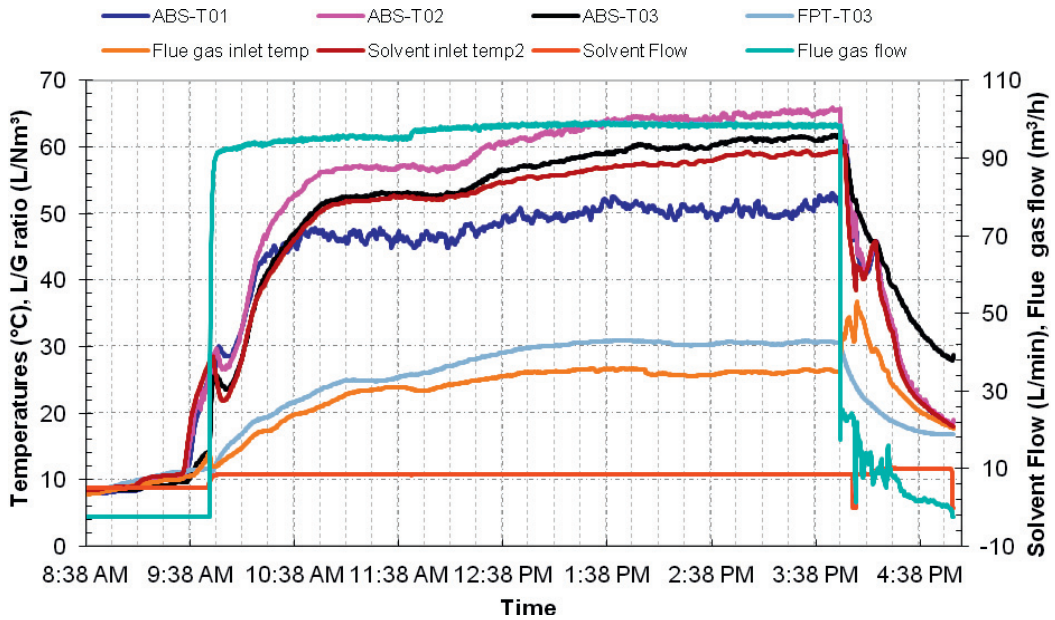


Fig. 4. Temperature profile of absorber column 2 at the CSIRO PCC pilot plant at Loy Yang Power on the date of 2 August 2012. The temperature transmitters (ABS-T01 to ABS-T02) are at various points on the absorber column; FPT-T03 is the temperature of the flue gas exiting the pre-treatment process. Note the scale for solvent flow and exit CO<sub>2</sub> gas flow is on the right hand side.

**Error! Reference source not found.** shows the effect of changing flue gas flow from 120 kg/h to 122 kg/h (at 11:45 AM) in the CSIRO PCC pilot plant at Loy Yang. The pilot begins at steady state and upon increasing the flue gas flow, the temperature began to increase in the absorber suggesting that the process is sensitive to flow changes. For this case, the response time of the CO<sub>2</sub> capture process to the change in flue gas flow was approximately 20 minutes. However, an additional 40 minutes was required for the system to reach steady state. This suggests that the total time required for the system to reflect a change in flue gas flow is 60 minutes. The lag in response time can be attributed to the solvent passage and mixing time of equipment (e.g. columns, feed tank and knock out separation tanks).

The “snapshots” approach to modelling dynamic behaviour using a steady state process simulation program was proposed by Gruber (2004) [25]. A similar approach can be applied to pilot plants to obtain consistent and reproducible dynamic data. After making small step changes to a flow rate parameter (i.e. either flue gas or solvent flow), the pilot plant is allowed to reach steady state. Temperature, pressure, CO<sub>2</sub> loading and concentration at steady state can be measured after each change in flow rate. The dynamic behaviour of the pilot plant is demonstrated by plotting these variables against the step changes in flow rate. As noted from **Error! Reference source not found.**, the step-wise procedure would require a time interval of at least 60 minutes between each measurement.

#### 4. Conclusion

The preliminary pilot plant data supports and suggests that the proposed step-wise procedure for collecting dynamic data has validity. The pilot plant used for this study has a response time of 20 minutes when a change is made to flue gas flow. Also, upon making a flue gas flow change, the pilot plant requires at least 60 minutes to reach steady state. The effect of successive step-wise changes to flue gas flow and solvent flow, as well as result reproducibility is under further investigation. This study will contribute to the development of a procedure for dynamic data collection from pilot plants. The validation of dynamic models with dynamic pilot plant data will be a significant contribution towards improving our understanding of dynamic behaviour in PCC plants. Furthermore, the validated dynamic model will be an essential tool to evaluate the feasibility of flexible operation in PCC plants.



## Acknowledgements

The generous support from CSIRO Energy Technology and Monash University is gratefully acknowledged. Acknowledgement and thanks to CSIRO Energy Technology for providing pilot plant data from their PCC pilot plant at Loy Yang in Victoria, Australia.

## References

- [1] IPCC, *Climate Change 2007: Synthesis Report. Contribution of Working Groups I, II and III to the Fourth Assessment Report of the Intergovernmental Panel on Climate Change [Core Writing Team, Pachauri, R. K., Reisinger, A. (eds.)]*, 2007, Intergovernmental Panel on Climate Change (IPCC): Geneva, Switzerland. p. 30-37.
- [2] Lenzen, M., et al., *Life-cycle energy balance and greenhouse gas emissions of nuclear energy in Australia*, in *Report for Uranium Mining, Processing and Nuclear Energy Review - Australian Government* 2006, written by University of Sydney. p. 93-94.
- [3] Cohen, S.M., G.T. Rochelle, and M.E. Webber, Turning CO<sub>2</sub> capture on and off in response to electric grid demand: A baseline analysis of emissions and economics. *Journal of Energy Resources Technology* 2010. **132**(2).
- [4] Houston, G., et al., *The Wholesale Electricity Market in Australia A report to the Australian Energy Market Commission*, 2007, NERA Economic Consulting: Sydney.
- [5] IEA, *Energy Technology Perspectives 2010*, 2010, International Energy Agency (IEA): Paris, France. p. 51.
- [6] Lawal, A., et al., Dynamic modelling and analysis of post-combustion CO<sub>2</sub> chemical absorption process for coal-fired power plants. *Fuel* 2010. **89**(10): p. 2791-2801.
- [7] Abu-Zahra, M.R.M., et al., CO<sub>2</sub> capture from power plants. Part I. A parametric study of the technical performance based on monoethanolamine. *International Journal of Greenhouse Gas Control* 2007. **1**(1): p. 37-46.
- [8] D'Alessandro, D.M., B. Smit, and J.R. Long, Carbon dioxide capture: Prospects for new materials. *Angewandte Chemie - International Edition* 2010. **49**(35): p. 6058-6082.
- [9] Wall, T.F., Combustion processes for carbon capture. *Proceedings of the Combustion Institute* 2007. **31**(1): p. 31-47.
- [10] Cottrell, A.J., et al. *Post-combustion capture R&D and pilot plant operation in Australia*. in *9th International Conference on Greenhouse Gas Control Technologies*. 2008. Washington DC, USA: Energy Procedia.
- [11] Wiley, D.E., M.T. Ho, and L. Donde. *Technical and economic opportunities for flexible CO<sub>2</sub> capture at Australian black coal fired power plants*. in *10th International Conference on Greenhouse Gas Control Technologies*. 2010. Amsterdam, The Netherlands: Energy Procedia.
- [12] Chalmers, H. and J. Gibbins, Initial evaluation of the impact of post-combustion capture of carbon dioxide on supercritical pulverised coal power plant part load performance. *Fuel* 2007. **86**(14 SPEC. ISS.): p. 2109-2123.
- [13] Chalmers, H., et al., Flexible operation of coal fired power plants with postcombustion capture of carbon dioxide. *Journal of Environmental Engineering* 2009. **135**(6): p. 449-458.
- [14] Cohen, S.M., G.T. Rochelle, and M.E. Webber, Optimal operation of flexible post-combustion CO<sub>2</sub> capture in response to volatile electricity prices. *Energy Procedia* 2011. **4**: p. 2604-2611.

- [15] Husebye, J., R. Anantharaman, and S.-E. Fleten, Techno-economic assessment of flexible solvent regeneration & storage for base load coal-fired power generation with post combustion CO<sub>2</sub> capture. *Energy Procedia* 2011. **4**: p. 2612-2619.
- [16] Harun, N., et al. *Dynamic Simulation of MEA Absorption Processes for CO<sub>2</sub> Capture from Fossil Fuel Power Plant*. in *10th International Conference on Greenhouse Gas Control Technologies*. 2010. Amsterdam, The Netherlands: Energy Procedia.
- [17] Jayarathna, S.A., B. Lie, and M.C. Melaaen. *NEQ rate based modeling of an absorption column for post combustion CO<sub>2</sub> capturing*. in *10th International Conference on Greenhouse Gas Control Technologies*. 2010. Amsterdam, The Netherlands: Energy Procedia.
- [18] Kvamsdal, H.M., J.P. Jakobsen, and K.A. Hoff, Dynamic modeling and simulation of a CO<sub>2</sub> absorber column for post-combustion CO<sub>2</sub> capture. *Chemical Engineering and Processing: Process Intensification* 2009. **48**(1): p. 135-144.
- [19] Kvamsdal, H.M. and G.T. Rochelle, Effects of the Temperature Bulge in CO<sub>2</sub> Absorption from Flue Gas by Aqueous Monoethanolamine. *Industrial & Engineering Chemistry Research* 2008. **47**(3): p. 867-875.
- [20] Lawal, A., M. Wang, and P. Stephenson. *Investigating the dynamic response of CO<sub>2</sub> chemical absorption process in enhanced-O<sub>2</sub> coal power plant with post-combustion CO<sub>2</sub> capture*. in *10th International Conference on Greenhouse Gas Control Technologies*. 2010. Amsterdam, The Netherlands: Energy Procedia.
- [21] Lawal, A., et al., Demonstrating full-scale post-combustion CO<sub>2</sub> capture for coal-fired power plants through dynamic modelling and simulation. *Fuel* 2010 Article in Press.
- [22] Lawal, A., et al., Dynamic modelling of CO<sub>2</sub> absorption for post combustion capture in coal-fired power plants. *Fuel* 2009. **88**(12): p. 2455-2462.
- [23] Lawal, A., et al., *Dynamic modeling and simulation of CO<sub>2</sub> chemical absorption process for coal-fired power plants*, in *10th International Symposium on Process Systems Engineering-PSE2009* 2009, Computer Aided Chemical Engineering: Brazil. p. 1725-1730.
- [24] Ziaii, S., G.T. Rochelle, and T.F. Edgar, Dynamic modeling to minimize energy use for CO<sub>2</sub> capture in power plants by aqueous monoethanolamine. *Industrial and Engineering Chemistry Research* 2009. **48**(13): p. 6105-6111.
- [25] Gruber, G. *Dynamic Model of a Scrubber Using Aspen Plus*. in *Aspen World 2004*. 2004. Orlando, Florida, USA: Merck & Co., Inc.